

RNMV-EI

INTELLIGENT MEDIUM VOLTAGE SOLID STATE SOFT STARTER
| CATALOG



Stock code: 833 586

Technical innovation benefits the world



雷诺尔

Shanghai RENLE
Science&Technology Co., Ltd.

Professional Manufacturer for Smart Grid • New Energy • Electric Drive

Shanghai RENLE Science&Technology Co., Ltd.



Shanghai Renle Science & Technology Co., Ltd is a system integrator of "industrial control solutions" and a professional manufacturer of "industrial control and application electrical". Renle' s business covers industrial automation products, intelligent power distribution, automation control systems etc. Our products include high and low voltage motor soft starters, high and low voltage frequency inverter, explosion-proof electrical appliance, high and low voltage reactive power compensation and harmonic control devices, EPS (Emergency Power

Supply), transmission control system, MCS, DCS, energy-saving transformation system and complete sets of LV/HV power transmission and distribution equipment etc. Our customers cover electric power, metallurgy, petroleum and petrochemical, military industry, mining, chemical industry, construction, building materials, pharmaceutical, municipal, textile Printing and dyeing, paper making, rubber and plastics, rail transit, hydraulic power, aerospace technology, new energy batteries, semiconductors and other industries.





雷诺尔

Shanghai RENLE
Science&Technology Co., Ltd.



Shanghai Renle has established R&D centers in China and Germany. Renle' s R&D center was identified as Shanghai Enterprise Technology Center. Renle has participated in preparation /revision of 14 national technical standards. Renle has successively passed the certification of ISO9001 Quality Management System, ISO 14001 Environment System, OHSAS ISO45001 Occupational Health and Safety Management System, CE, TUV, CU-TR and national CCC etc.

Shanghai Renle' s vision: To build a century-old renowned company and be a respected high-tech electrical company; Mission: We are committed to the manufacture, R&D and service of industrial automation products and systems. We promise to improve production efficiency and energy efficiency for customers, and create a beautiful world together.



RENLE

Technical innovation benefits the world



5G industrial IoT
technology endorsement



Scan the code to watch
product technical
presentation video

RNMV-EI

INTELLIGENT MEDIUM VOLTAGE SOLID STATE SOFT STARTER

High voltage motors are important equipment at industrial sites. As the pre-driver of the motor, the high voltage soft starter is not only a starting device, but also a natural data source of the motor IoT;


With Industrial IoT 5G endorsement, and based on Renle's years of technology accumulation, the high voltage power modules realize full digitalization with the use of optical fiber multiplexing technology. The newly developed intelligent soft starters are equipped with standard industrial Ethernet and a variety of communication interfaces. Relying on industrial Ethernet, the soft starter realizes remote data analysis, remote software upgrade, remote debugging, remote virtual oscilloscope and other digital technologies.

RNMV-EI

INTELLIGENT MEDIUM VOLTAGE SOLID STATE SOFT STARTER





- ✓ Fiber multiplexing technology
- ✓ Full digitalization of high voltage power modules
- ✓ Different communication interfaces
- ✓ Industrial Ethernet communication
- ✓ Remote data analysis
- ✓ Remote software upgrade

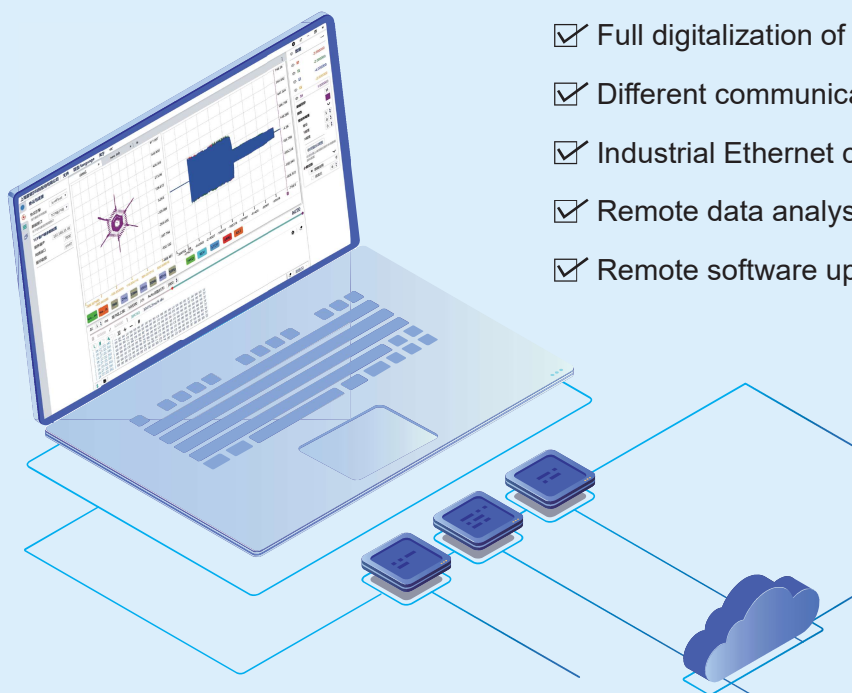

Data Visualization and Analysis

Real-time display of all data and running status

1. Soft starter is connected to the IT platform through the network protocol, and visualization of motor data is realized with IT technology;
2. Connection to the cloud server provides data for big data analysis and related artificial intelligence algorithms;
3. Full use of computing power of the cloud platform realizes online analysis and diagnosis of motor operation status, and realizes fault warning and optimal control.

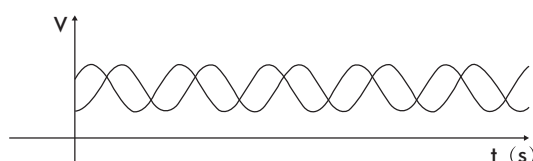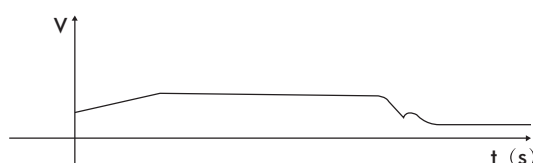

Model Description

RNMV – □□□ □□□□ – EI □

- None: Regular;
- S1: The cabinet contains circuit breaker, bypass contactor and soft starter (integrated cabinet);
- S2: The cabinet includes line contactor, bypass contactor and soft starter;
- S3: Mining;
- EI: Intelligent series

Rated current: Maximum value of rated current of the motor;
Such as: "150A, 330A, 500A, 700A, 1000A";

Voltage level: Nominal voltage (-15~+10%);

| | | | | | | |
|------------------|-----|-------|-----|-------|------|------|
| Nominal value | 030 | 033 | 060 | 066 | 100 | 110 |
| Applicable range | 3kV | 3.3kV | 6kV | 6.6kV | 10kV | 11kV |

Manufacturer's code: Shanghai Renle's MV solid state soft starter

Note: Default protection level is IP4X

Standard

- GB 311.1-1997 《Insulation co-ordination for high voltage transmission and distribution equipment》
- GB3906-2006 《Alternating-current metal-enclosed switchgear and controlgear for rated voltages above 3.6kV and up to and including 40.5kV》
- GB/T 13422-1992 《Power semiconductor converters-Electrical test methods》
- GB/T 3859.1-1993 《Semiconductor convertors – Specifications of basic requirements》
- GB/T 3859.2-1993 《Semiconductor convertors – Application guide》
- GB 4208-2008 《Degrees of protection provided by enclosure (IP code)》
- IEC-60298 《AC metal-enclosed switchgear and controlgear for rated voltages above 1kV and up to and including 52kV》
- IEC 60470 《High-voltage alternating current contactors》
- IEC 61000 《Electromagnetic compatibility (EMC)》
- JB/Z102 《Technical conditions for high-voltage apparatus used in high altitude area》
- GB/T 11022-1999 《Common specifications for high-voltage switchgear and controlgear Standards》

Executed standards of high voltage soft starter controller for general type for mining



GB/T 12173-2008《Mining electrical apparatus for non-hazardous area》

JB/T 10251-2001 《AC power & Electronic motor soft starters》

GB/T 3859.1-1993 《Semiconductor converters-Specifications of basic requirements》

GB/T 3797-2005 《Electrical control assemblies》

DL/T 593-2006 《Common specifications for high-voltage switchgear and controlgear standards》

DL/T 404-2007 《Alternating-current metal-enclosed switchgear and controlgear for rated voltages above 3.6kV and up to and including 40.5kV》

GB/T 14808-2001 《High voltage alternating current contactors and contactor-Based Motor-starters》

GB 1207-2006 《Inductive voltage transformers》

GB 1208-2006 《Current Transformers》

Technical features

- Thyristor valve group series connection and dual power supply triggering technology is adopted;
- Optical fiber communication multiplexing technology is adopted for driving and data collection;
- Monitor and display system status and data in real time with HMI, and it is possible to modify and set the system parameters;
- Equipped with OBD and software dual overvoltage protection functions.
- Statistics of valve group limit data are performed after each startup to evaluate the system status;
- Synchronous use of phase-locked loop and three-phase conduction compensation technology control algorithm;
- Protections include: undervoltage, phase loss, overcurrent, overheating, thyristor overvoltage, triggering failure, abnormal voltage sharing, abnormal RC current, thyristor failure, optical fiber communication interruption, abnormal triggering power supply etc. Start of the soft starter is prohibited when identification is abnormal;
- Remote software update, commissioning, data waveform monitoring and fault analysis is realized through InterNet;
- After connecting to the cloud server through industrial Ethernet + 5G, the soft starter provides data for big data analysis and related AI algorithms, makes full use of the computing power of the cloud platform to realize online analysis and diagnosis of motor operating status, and realizes fault pre-warning and optimized control.

Soft Start Function


- Strong load adaptability, with 2 starting control modes:
 - ① Constant current mode: Nominal current of motor start is limited to the range of 100-500%.
 - ② Voltage ramp mode: Control angle makes the output voltage linearly rise to the rated voltage.
- Free stop or soft stop is optional: Suitable for different stop occasions to meet special needs, such as to eliminate the water hammer effect of the water pump.

5G Industrial Ethernet Communication Technology

Based on industrial Ethernet + cloud platform,


Realization of fully remote in-depth technical support for field equipment.

Data reading->waveform display->data diagnosis->software upgrade

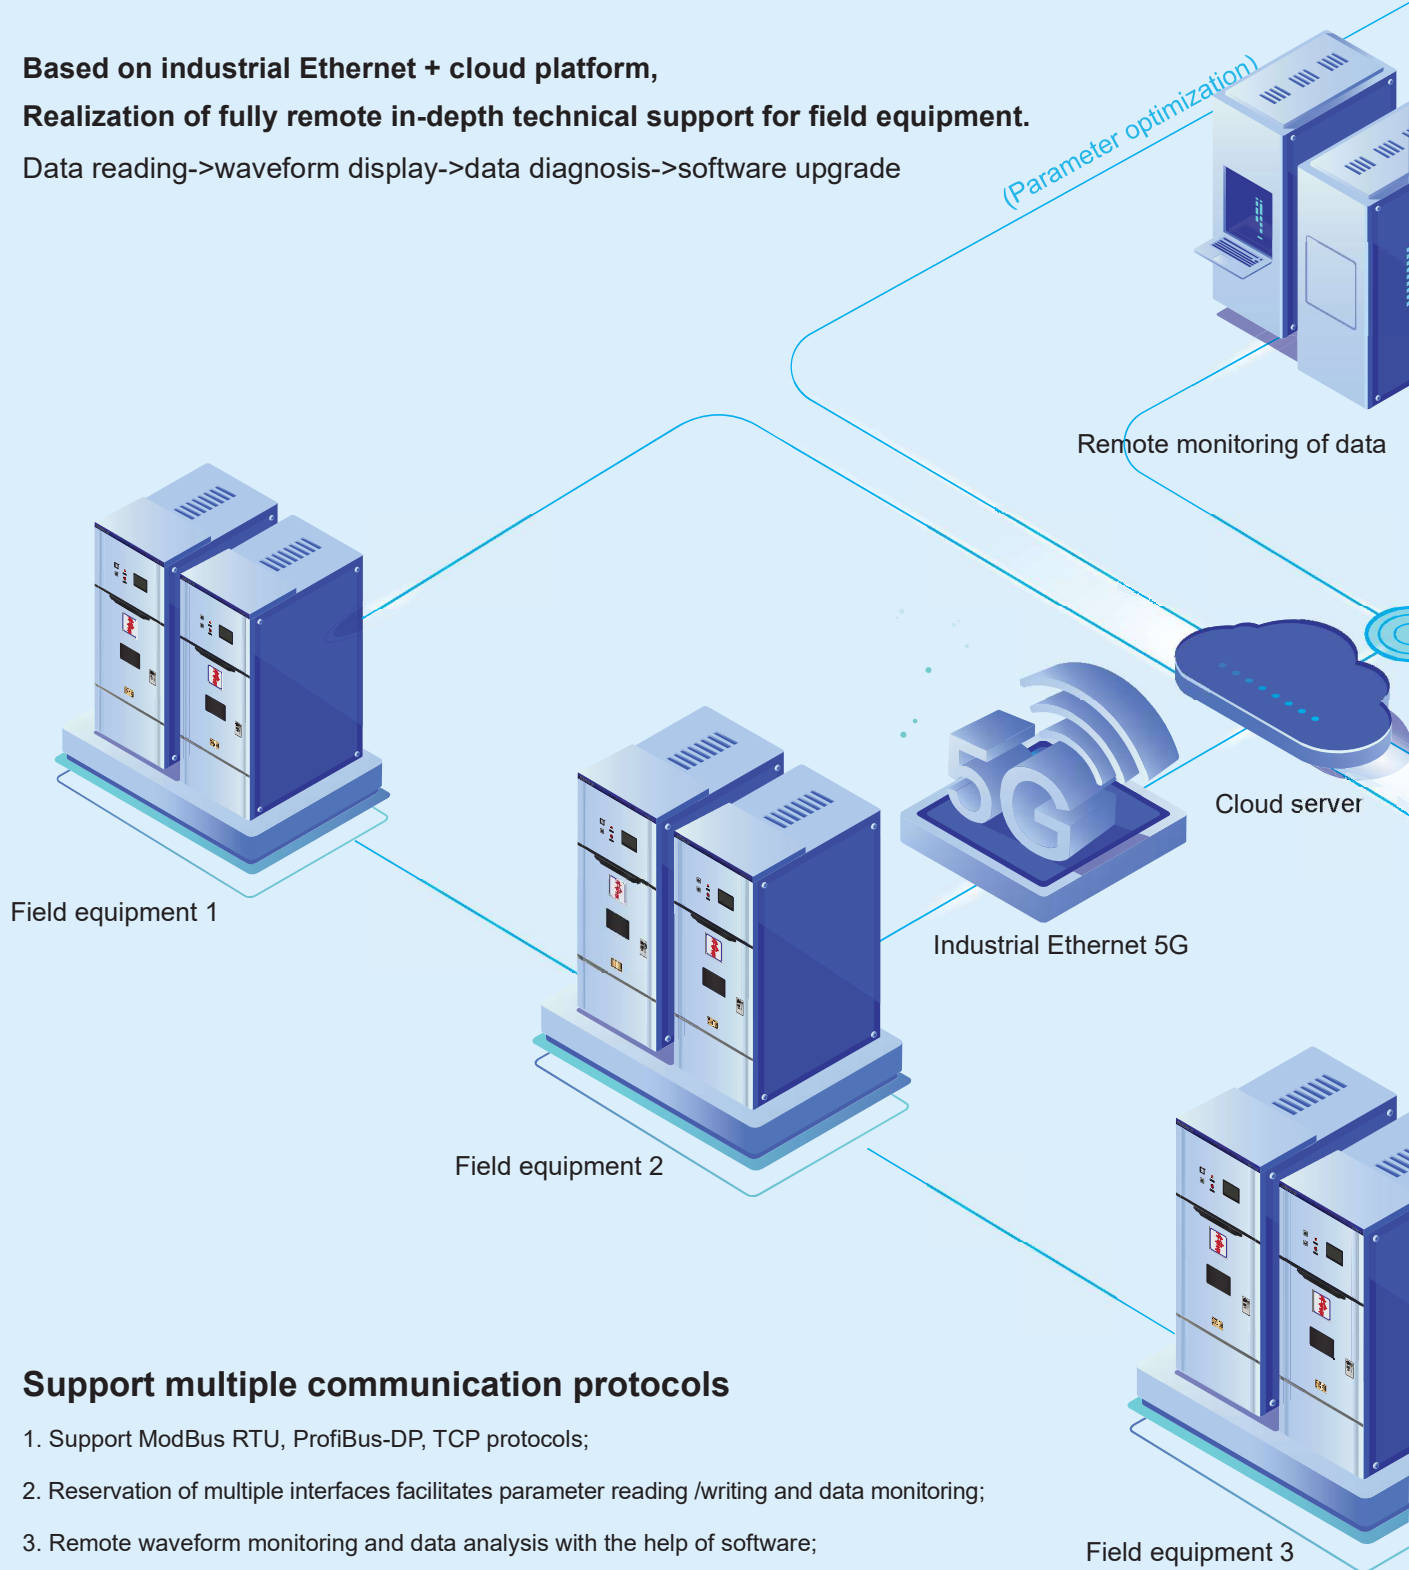

Support multiple communication protocols

1. Support ModBus RTU, ProfiBus-DP, TCP protocols;
2. Reservation of multiple interfaces facilitates parameter reading /writing and data monitoring;
3. Remote waveform monitoring and data analysis with the help of software;
4. Data download and software upgrade is performed with FTP and TFTP.

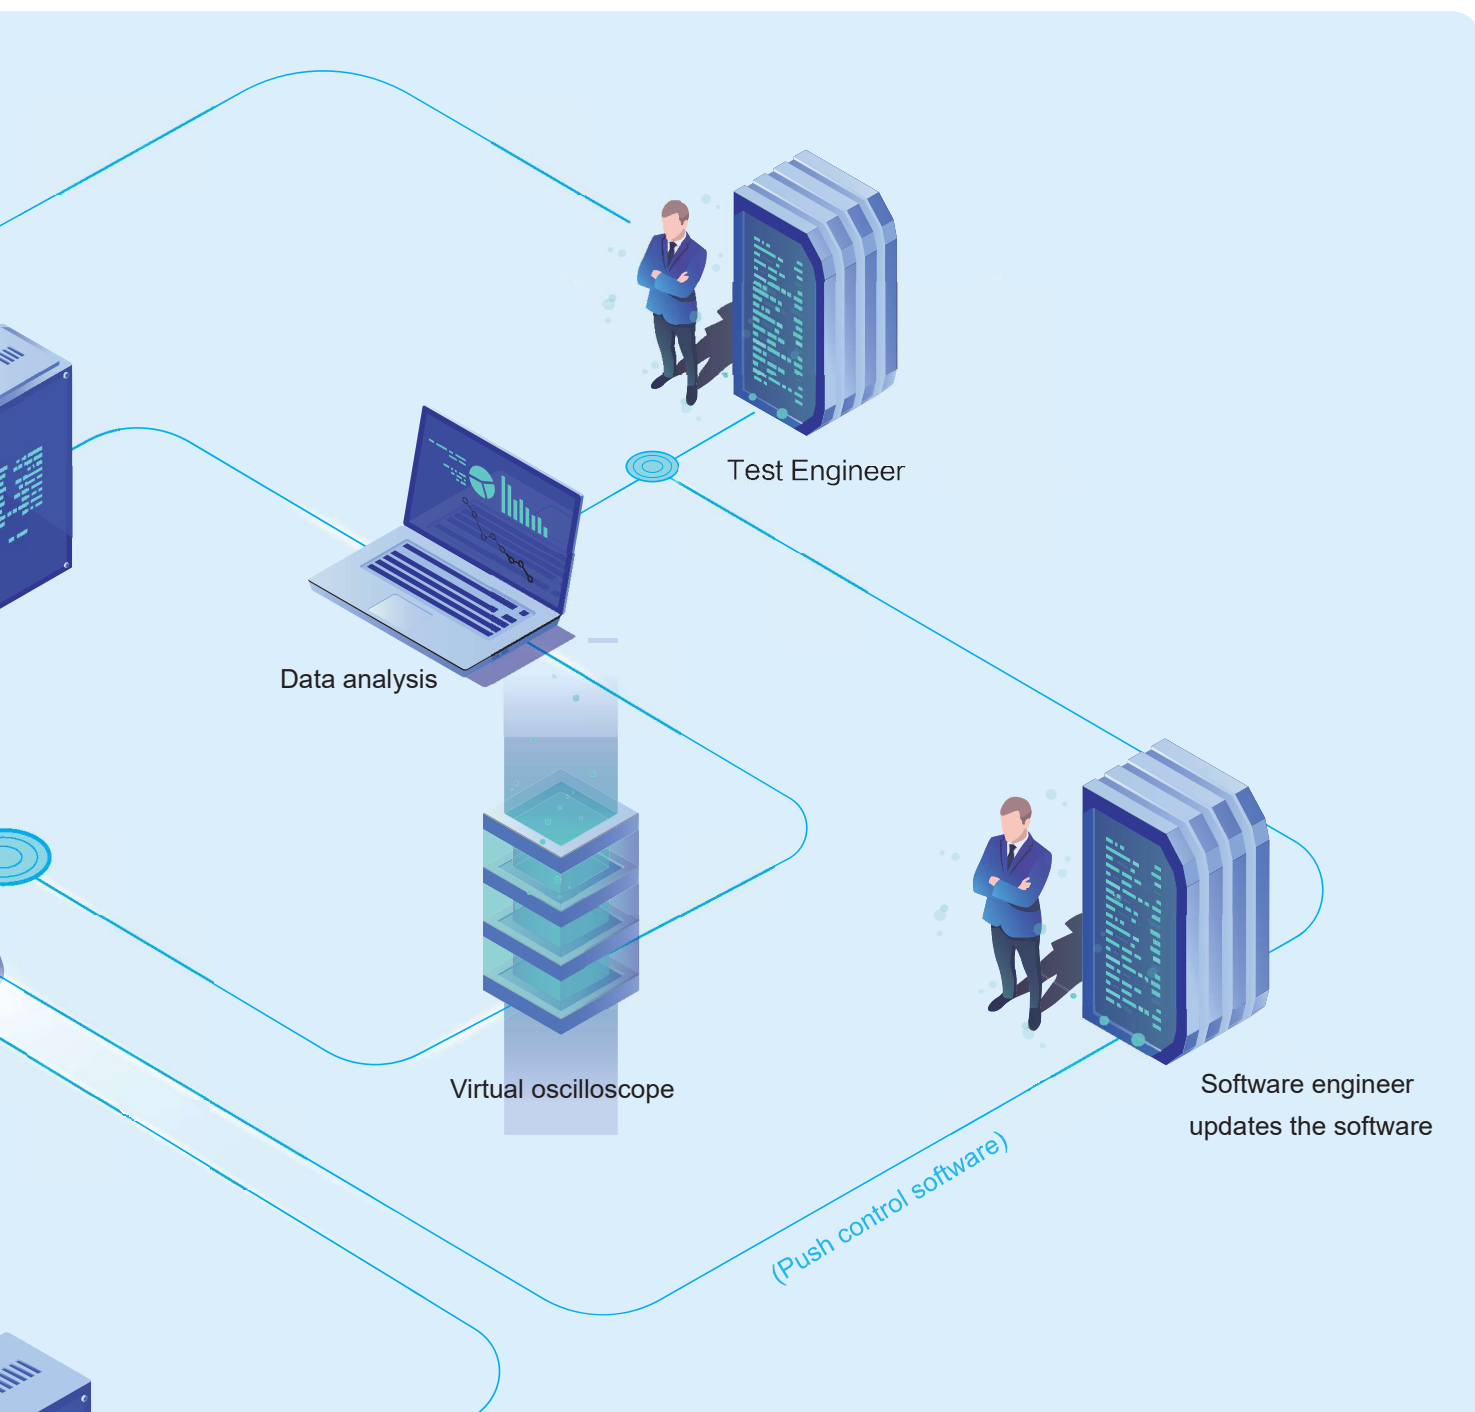

Application environment



Temperature

Cabinet temperature
0°C~40°C (Optional
heater for -20°C~0°C)



Humidity

5%~95%
relative humidity



Altitude

Below 2000m. Derating is
necessary for altitude
above 2000m




Place

Indoors, no explosive
or corrosive gas, with
low dust

Operation Panel

RNMV-EI series soft starters monitor status and display data with HMI.

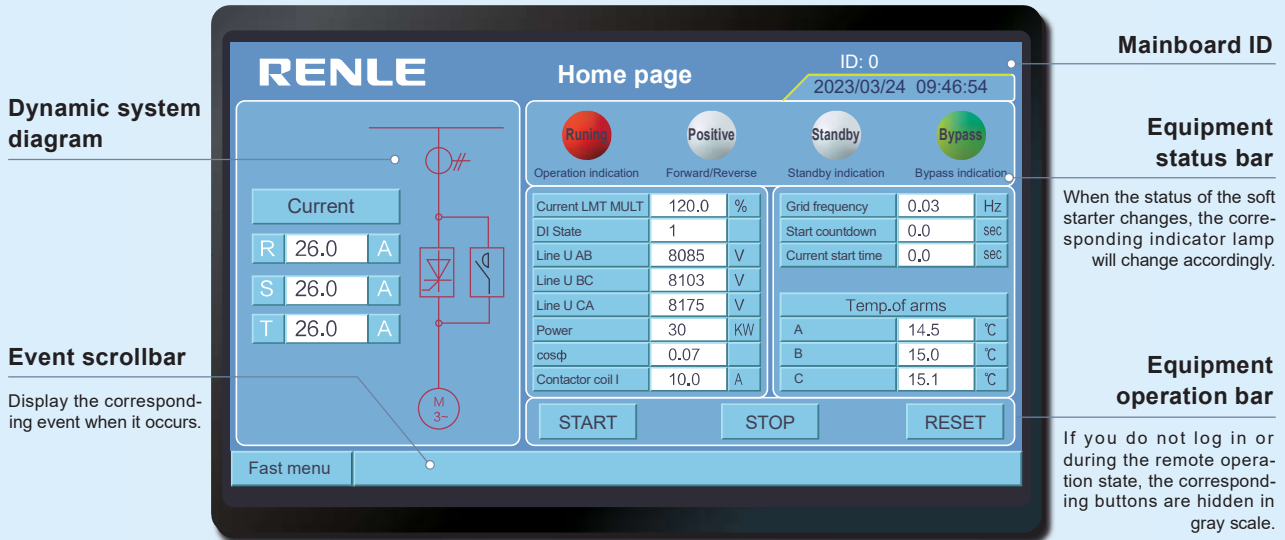

Indicator lamp name Function


| | |
|---|--|
| Running indicator lamp | Red color indicates the soft starter is in running state; otherwise, the lamp is green. |
| Positive phase sequence /reverse phase sequence | This lamp indicates the phase sequence of incoming line of power supply of the equipment. |
| Standby indicator lamp | When the equipment is in the shutdown state, and the indicator lamp is white, it shows that the equipment is ready for start, and the soft starter can be started normally. Otherwise the soft starter can not be started when the lamp is gray. |
| Bypass indicator lamp | When the lamp is orange color, it indicates the equipment has finished start and entered in the state of bypass. Otherwise the lamp is green. |

Data name Description

| | |
|---------------------------|---|
| Current limiting multiple | Currently set starting current limiting multiple, equal to the setting value of parameter n112. |
| Phase sequence | Incoming line phase sequence of existing equipment. 1 represents positive phase sequence, -1 represents reverse phase sequence. |
| Line voltage | Existing grid line voltage. |
| Power | Existing motor output power. |
| Power factor | Existing motor power factor. |
| Grid frequency | Existing grid frequency. |
| Zero sequence current | Existing motor power factor. |
| Module temperature | Maximum temperature of module at each phase. |
| Current | Existing three-phase current of the motor. |

Full digitalization of power modules

RENLE

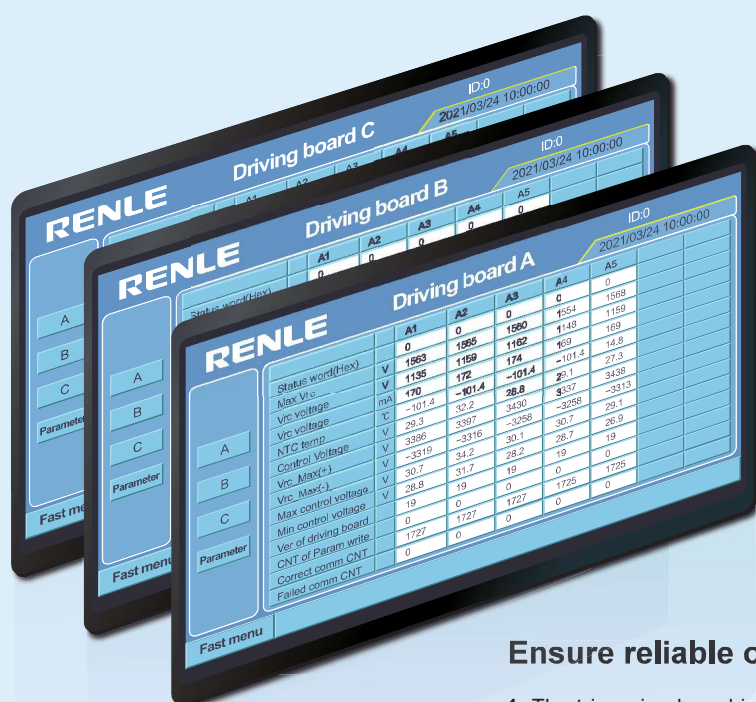

Ensure reliable operation of series thyristors

1. The triggering board is equipped with an MCU monitoring system which records the status of the power modules of each start.
2. Collect important data of power modules at each level:
 - Vrc voltage: Existing voltage over each RC group;
 - Forward and reverse Vrc peak voltage: Forward and reverse peak voltage over each RC when the soft starter is started;
 - Control voltage: The average/maximum/minimum value of control voltage of each group of positive triggering boards;
 - RC current: Average current value of each group of RC.
3. Standard SCR overvoltage self-triggering function, and hardware and software dual settings, which can ensure the safety of SCR.

Technical Parameters

| Data Name | Working Range |
|--------------------------------|--|
| Rated working voltage | 3~13.8kV (-15%~+10%) |
| Frequency | 50Hz/60Hz±2Hz (selected according to user's grid) |
| Overload capacity | 400% control nominal value 60s 500% control nominal value 30s |
| Applicable motor | Three-phase squirrel-cage asynchronous and synchronous motor |
| Application environment | |
| Temperature | Cabinet temperature 0°C~40°C, (Heater is optional for -20°C~0°C) |
| Humidity | 5%~95% relative humidity |
| Altitude | Below 2000m. Derating is necessary for altitude above 2000m. |
| Place | Indoors, no explosive or corrosive gas, with low dust. |
| Cooling | Natural cooling |
| Protection level | IP4X |

Structural features

| | |
|--------------------------|---|
| Operation power supply | 2kVA AC220V supplied by the user (can be specified). |
| Main circuit | The number of thyristors is determined by the model. |
| Communication protocol | Integrated Modbus RTU, PROFIBUS-DP, CAN and Modbus TCP/IP communication protocols, and equipped with interface. |
| Communication interface | Port RJ45 |
| Operation interface | 7-inch touch screen (HMI) which monitors system status in real-time. Used for setting and modifying parameters. |
| Event record | It can continuously record event records and historical curves with time and date stamps within 10 days. |
| Performance monitoring | Current, voltage, power factor, module temperature, RC average and peak voltage, RC current, etc. |
| Input and output options | 10 channels of 24VDC programmable inputs, 2 channels of 16A and 4 channels of 5A programmable outputs, 1 analog programmable output. |
| User management | Multi-level user password protection (can be specified). |
| Interface language | Chinese, English, Russian (can be specified) |
| Thyristor | Thyristor valve group in series. |
| Drive and data | Dual power supply triggering, optical fiber communication multiplexing technology; Adopting synchronous phase-locked loop, three-phase conduction compensation algorithm; Equipped with OBD and software double overvoltage function; After startup is completed, the valve group limit data are counted for evaluating the system status. |
| Monitoring | HMI window, used for real-time monitoring of system status, collection of valve group data and setting and modification of control parameters. |
| Protection | Undervoltage, overvoltage, phase loss, overheating, abnormal voltage sharing, abnormal RC current, thyristor failure, optical fiber communication interruption, abnormal triggering power supply etc. |
| Cloud service | Remote software update, commissioning, data waveform monitoring and fault analysis is realized through InterNet; After connecting to the cloud server through industrial Ethernet + 5G, the soft starter provides data for big data analysis and related AI algorithms; makes full use of the computing power of the cloud platform to realize online analysis and diagnosis of motor operating status, and realizes fault pre-warning and optimized control. |
| Cabinet color | Selected by the user. |


Start data

| | |
|------------------|--|
| Starting current | Adjustable within 4 times of the rated current of the motor. |
| Starting time | Adjustable within 10~60 seconds. |
| Number of starts | 6 times per hour at an ambient temperature of 25°C. |
| Start interval | No less than 5 minutes between two starts. |

Protection parameters


| | |
|----------------------------|---|
| Instantaneous overcurrent | Protection range 200%~800% |
| Inverse time overcurrent | The protection time is 1 minute for 1.5 times, used for protecting the motor during bypass operation. |
| Incoming line undervoltage | Range: 0%~100% |
| Grounding | Ground protection is identified by zero-sequence current. |
| Output phase loss | Set the threshold 1.0%~50% according to the parameters by comparison of the three-phase output current. |
| Thyristor breakdown | Set action threshold through parameters by monitoring voltage of each level of thyristors. |
| RC current | Monitor RC closing current of each level of thyristors and identify RC is working status. Current deviation can be set. |
| Trigger failure | During startup, the number of triggering failure exceeds the set parameter value within 2 seconds of detection window, so protection acts. |
| Start timeout | The start time is greater than the set value. |
| Triggering power | If the power of the triggering board is lower or higher than the hardware protection value, or higher than the hardware protection value, protection of triggering board power acts. |
| Temperature | SCR temperature exceeds the set parameters. |
| Thyristor overvoltage | During the starting process, each level of SCR is equipped with OBD protection. During one starting process, the number of overvoltage automatic triggering reaches the set parameter, the protection is performed. |

Schematic Diagram of Input and Output Interfaces

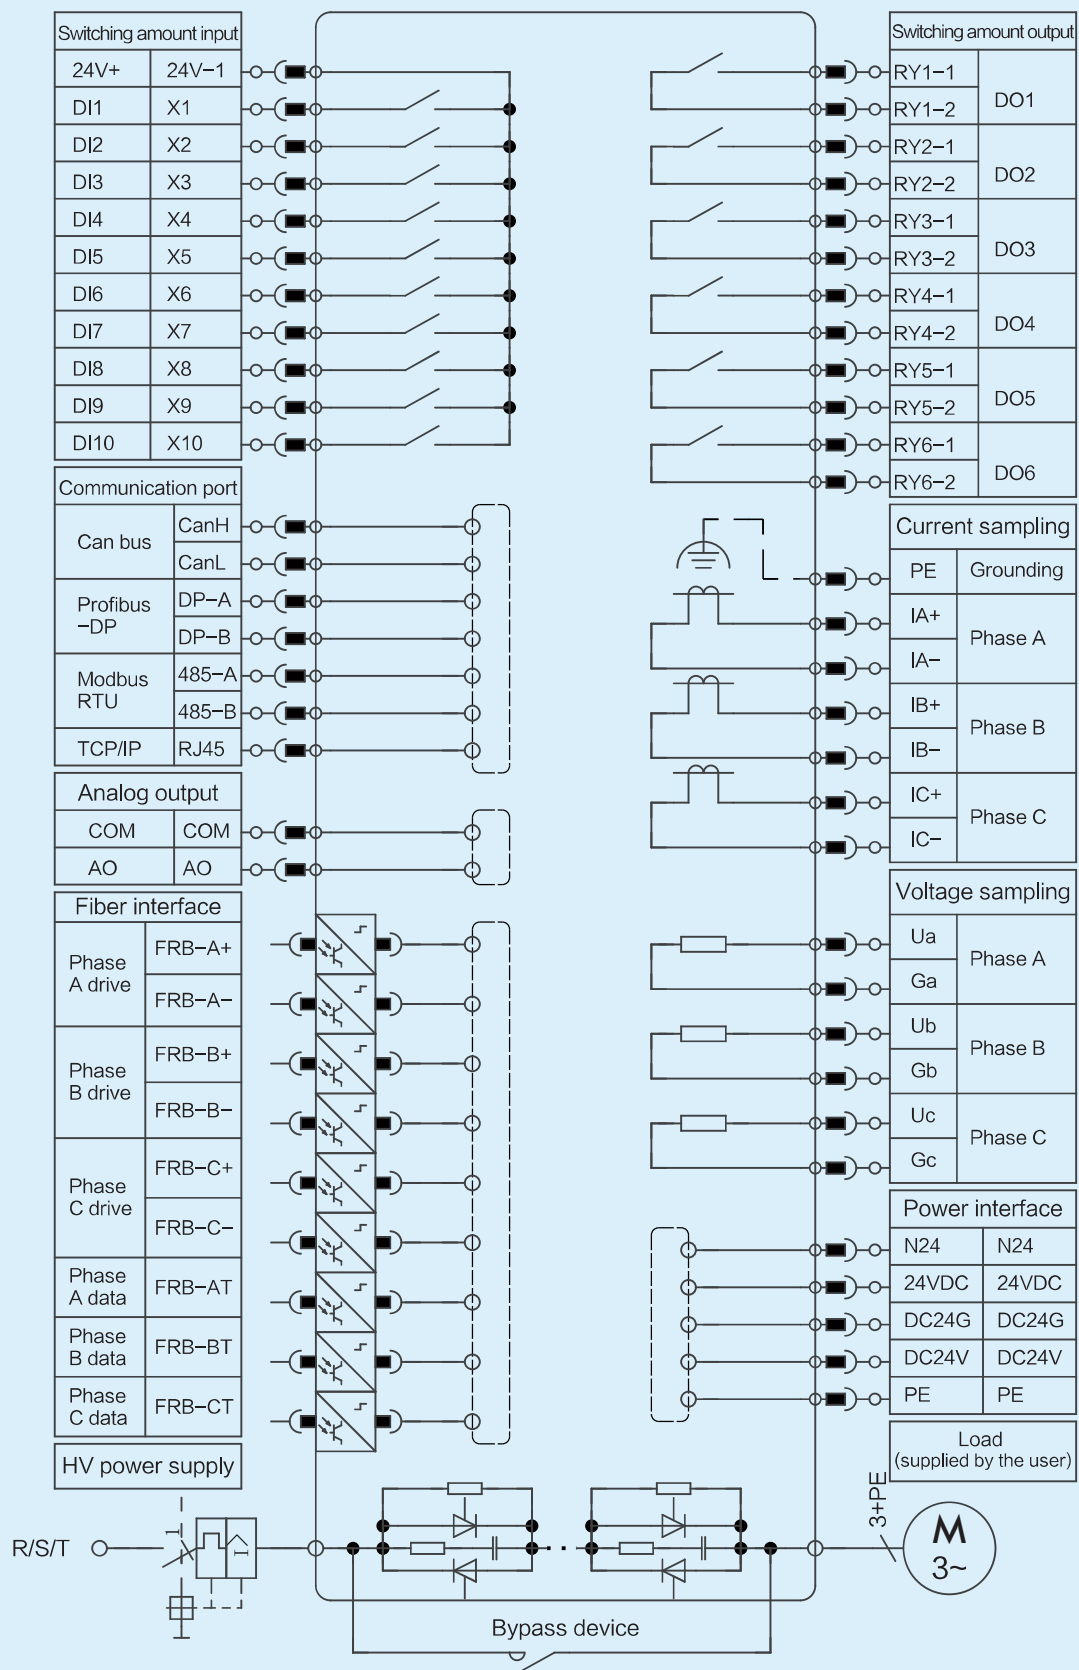

System Composition

The system consists of three phase contact arms A, B, C.

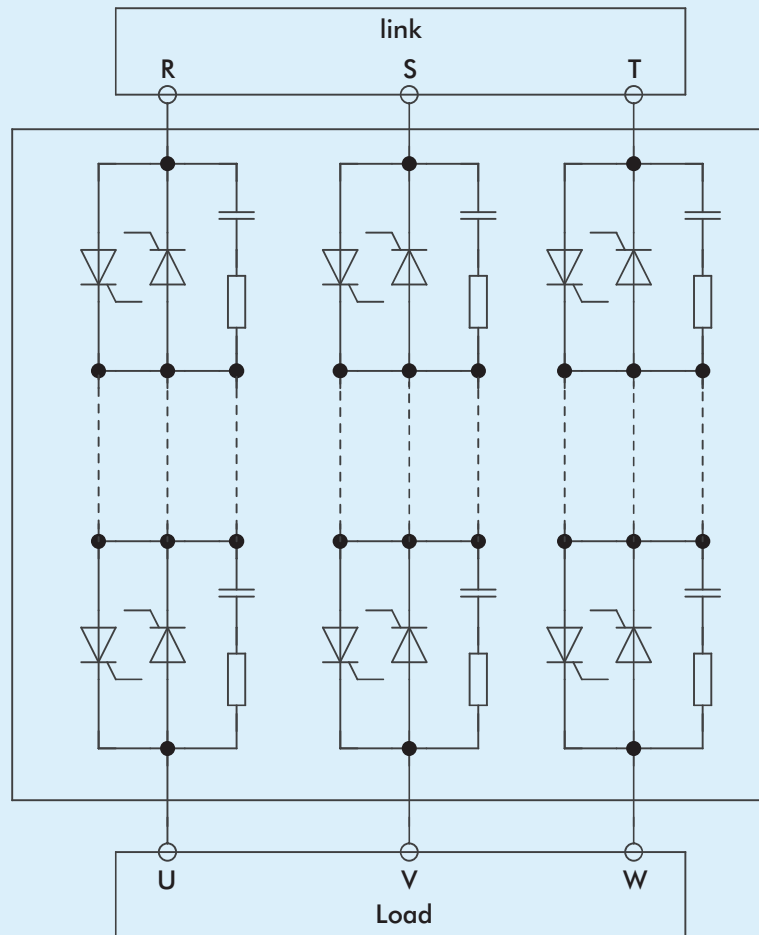

Topology diagram of power modules

Each thyristor series valve group includes: thyristor, driving board, power supply and optical fiber board, resistor and capacitor;


Thyristor: the main power device, the specific data of which are determined by the device current and the system voltage;

Driving board: Convey the control commands given out by the main control board to control the on-off of the thyristors;

Power supply and fiber optic board: accept instructions of the main control board to provide driving power and driving commands for the driving board, and return data collected by the driving board to the main control board;

Resistor and capacitor: balance the voltage distribution on the thyristors of the series valve group and accelerate turning off of thyristors.


Primary Control Plan

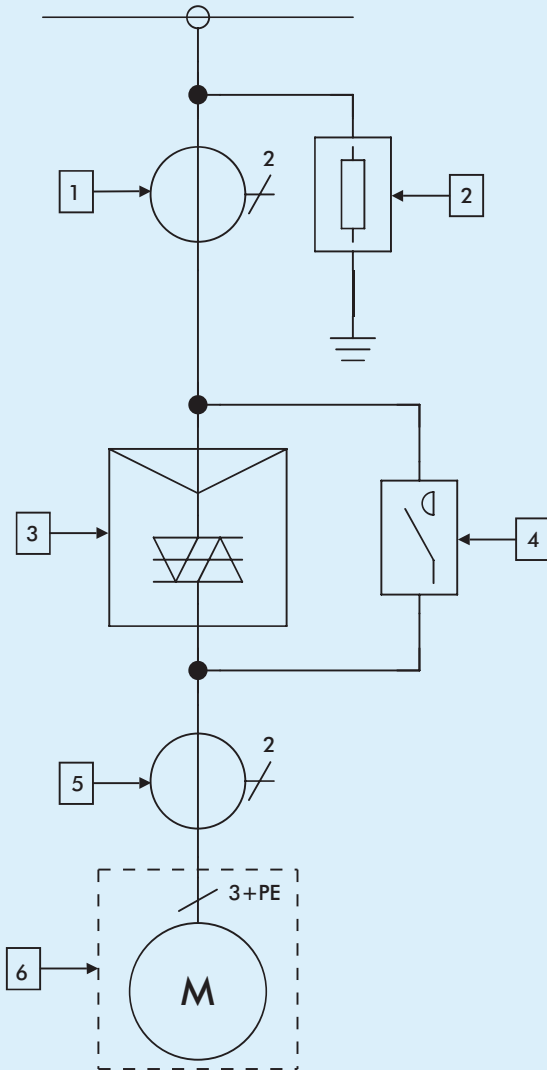

Primary Control Plan

- 1. Current transformer:** Used for current measurement and current control;
 - 2. Voltage sensor:** Used for voltage measurement, phase sequence detection, synchronous sampling and voltage control;
 - 3. Thyristor series valve group:** It includes thyristors, drive, protection, detection, voltage sharing and heat dissipation etc.;
 - 4. Bypass contactor:** Used to switch the main circuit to power frequency after successful soft start;
 - 5. Zero sequence transformer:** Optional;
 - 6. Squirrel cage motor:** Provided by the customer;
- Note: If it is necessary to connect a reactive power compensation device, it can only be connected to the power supply end of the soft starter, and cannot be installed at the output end of the soft starter.



General Application Schematic Diagram

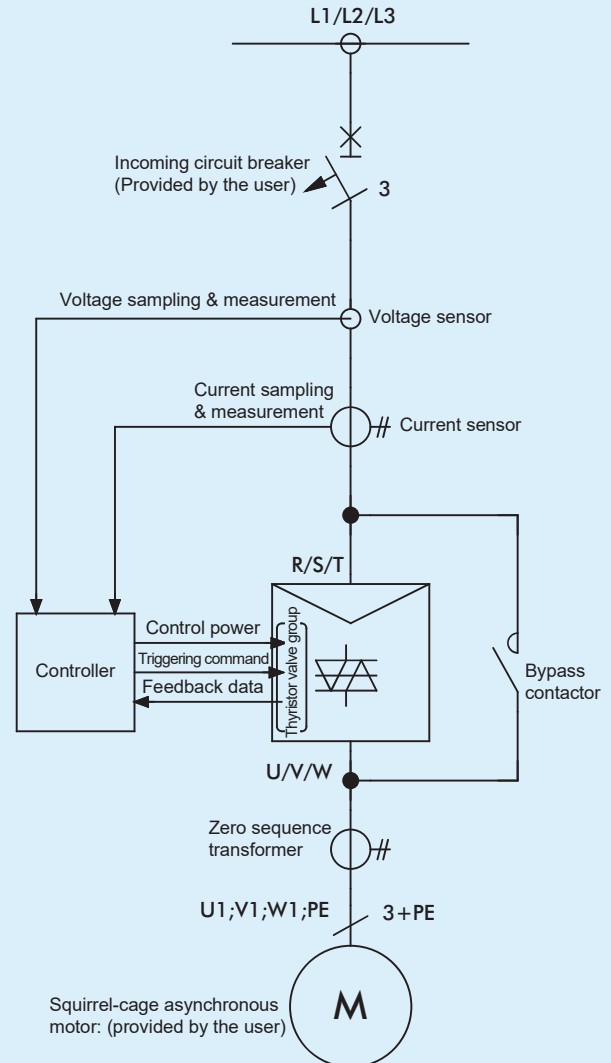


General Application Schematic Diagram

- 1. Incoming circuit breaker:** Provided by the user;
- 2. Voltage sensor:** Used for voltage detection, phase sequence detection and synchronous sampling;
- 3. Current sensor:** Used for current detection;
- 4. Thyristor valve group:** Strictly screened anti-parallel thyristor string;
- 5. Controller:** The core of soft-start control;
- 6. Bypass contactor:** For switching the motor to power frequency after starting;
- 7. Zero sequence transformer:** Optional;
- 8. Squirrel-cage motor:** Provided by the user.


Conventional Secondary Schematic Diagram

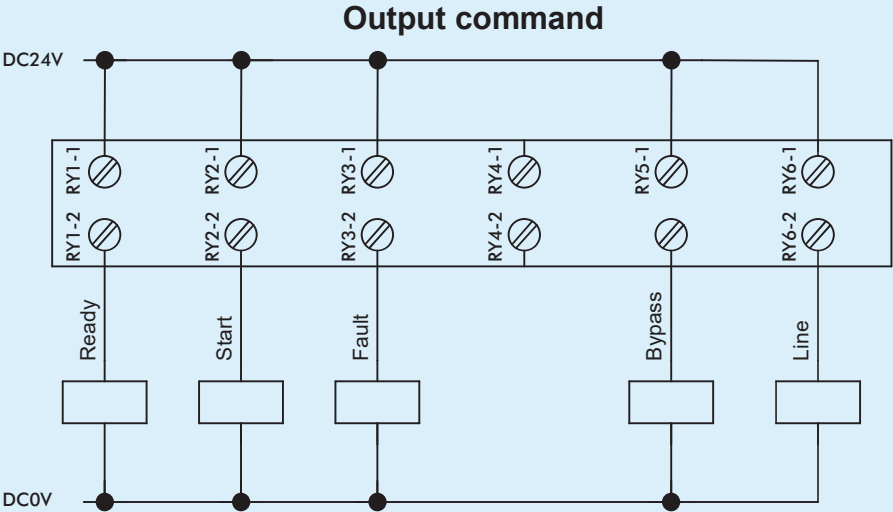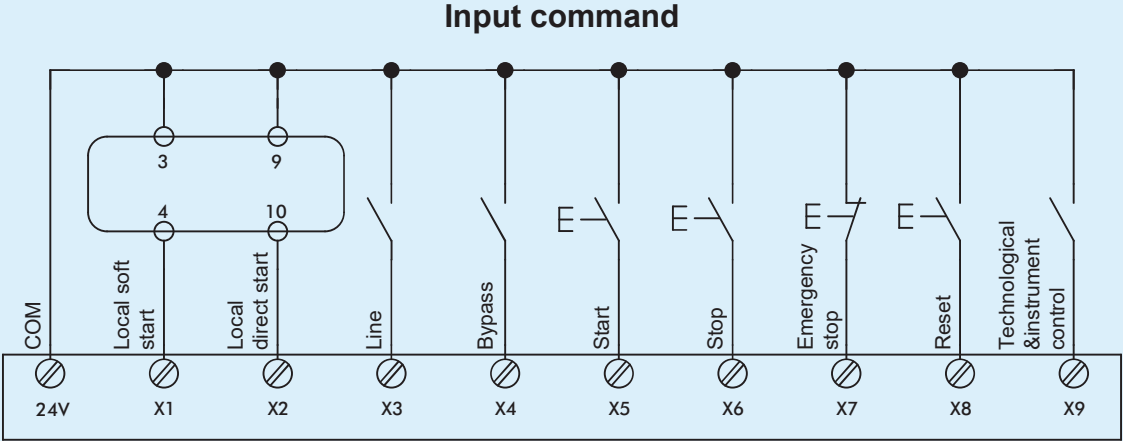


Voltage detection

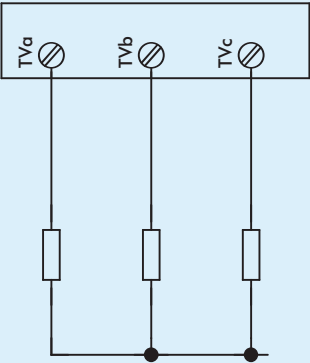


Current detection

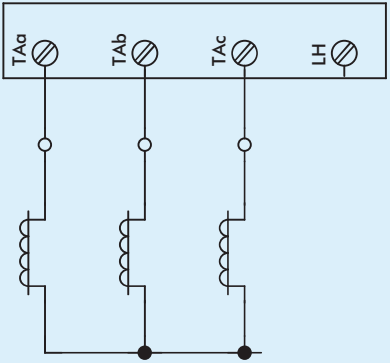


Application Scheme Diagram

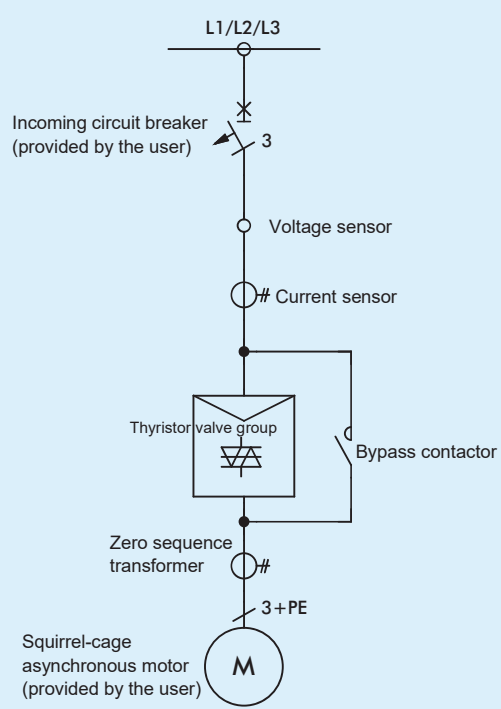


Conventional plan

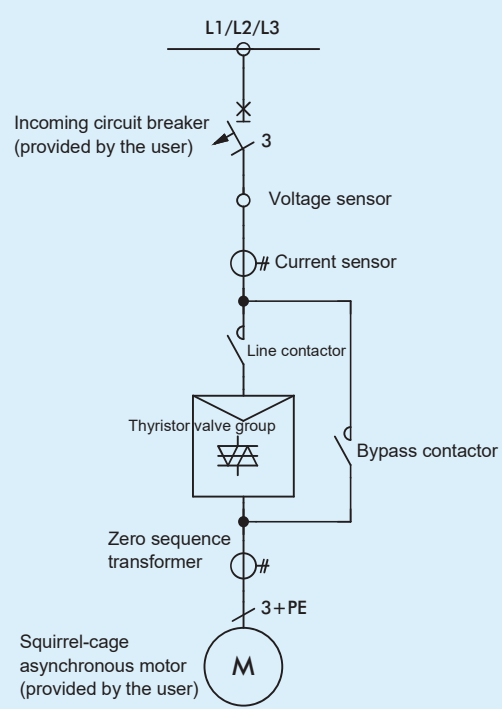

Plan with line contactor

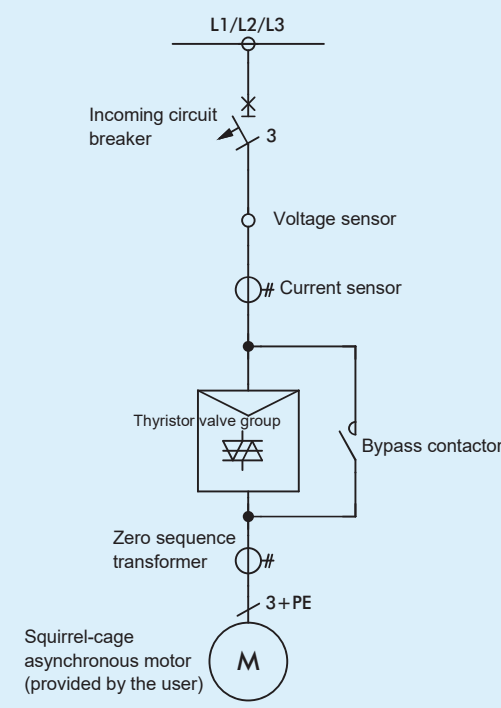

"Three-in-one" plan

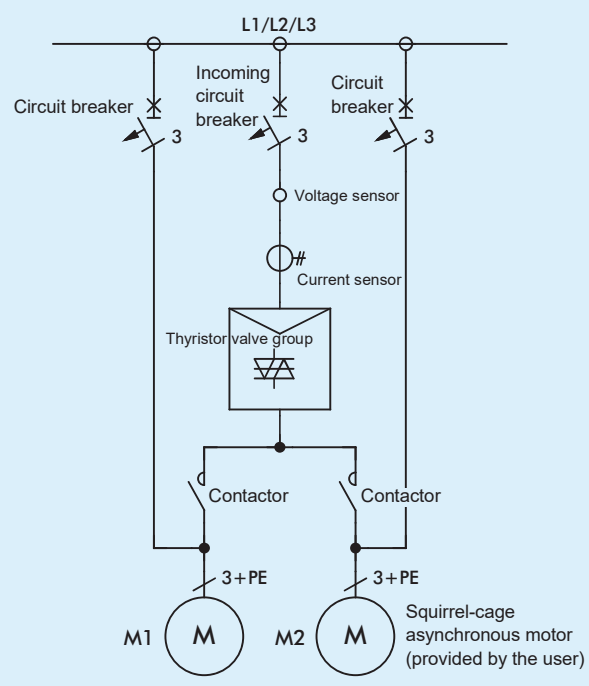

"One drives two" plan




Conventional type

MV Solid Soft Starter

- ✓ Fiber multiplexing technology
- ✓ Full digitalization of high voltage power modules
- ✓ Different communication interfaces
- ✓ Industrial Ethernet communication
- ✓ Remote data analysis
- ✓ Remote software upgrade




Front view

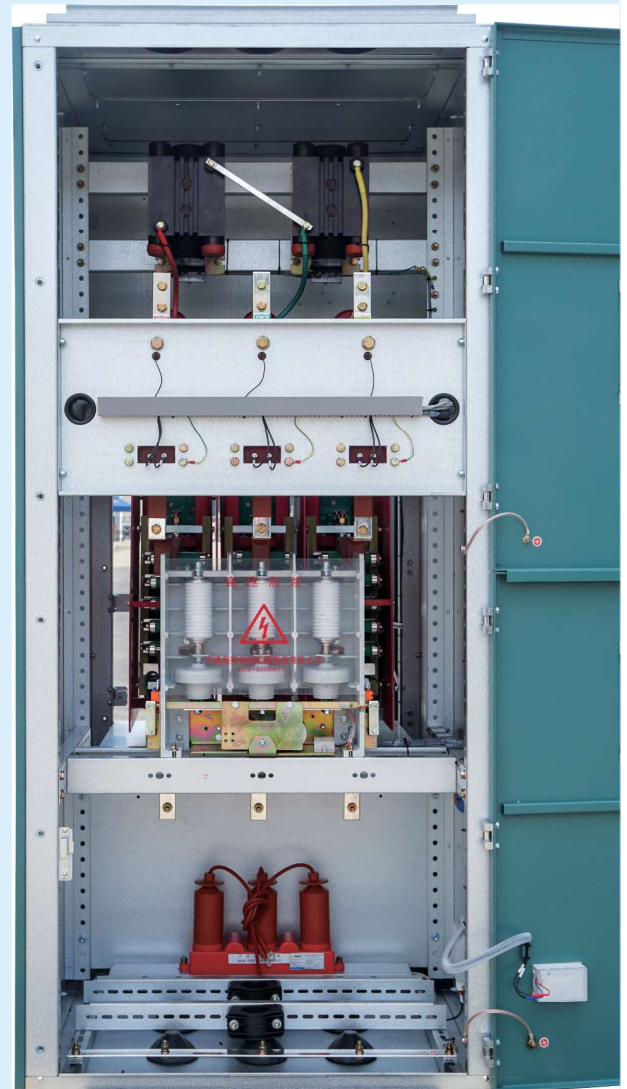

Back view

Schematic Diagram of Conventional Cabinet

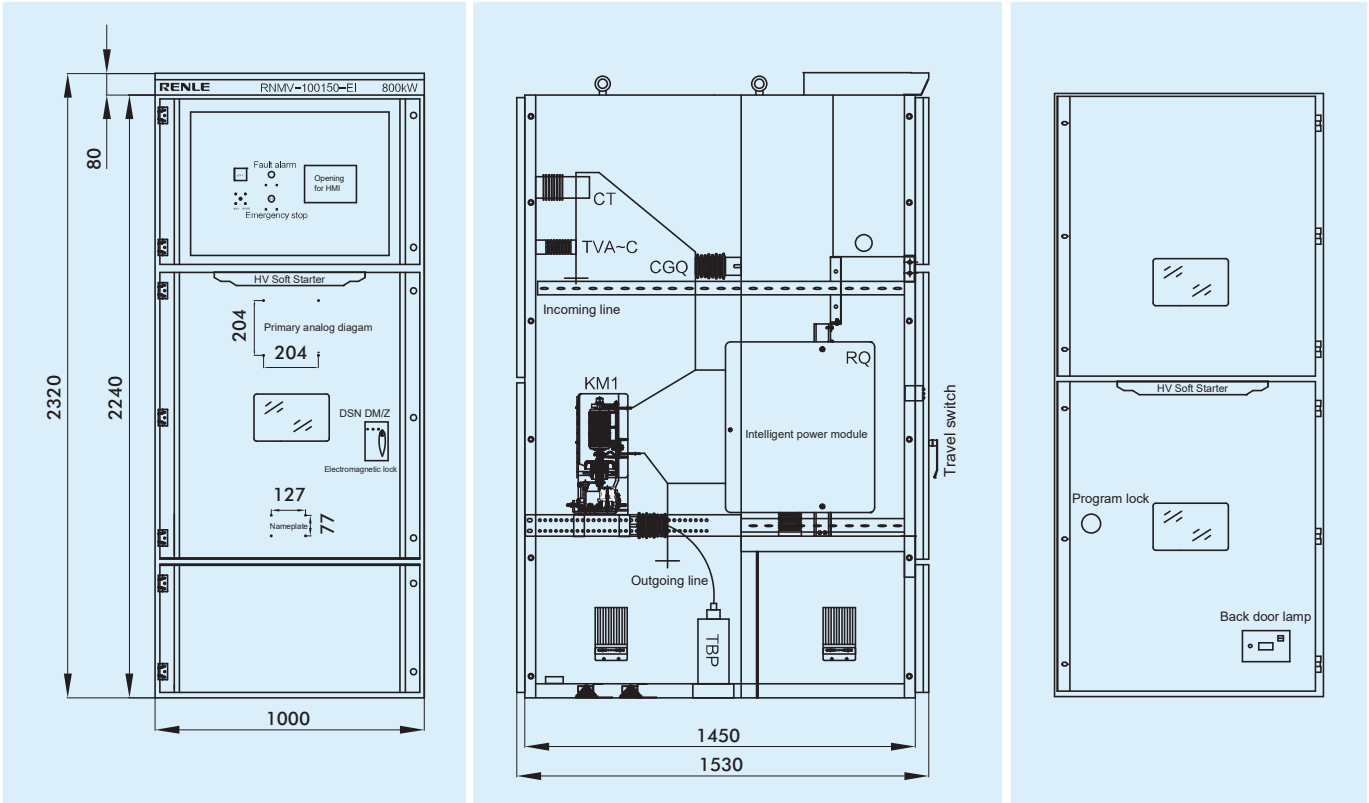


Front view

Side view

Back view

Installation method

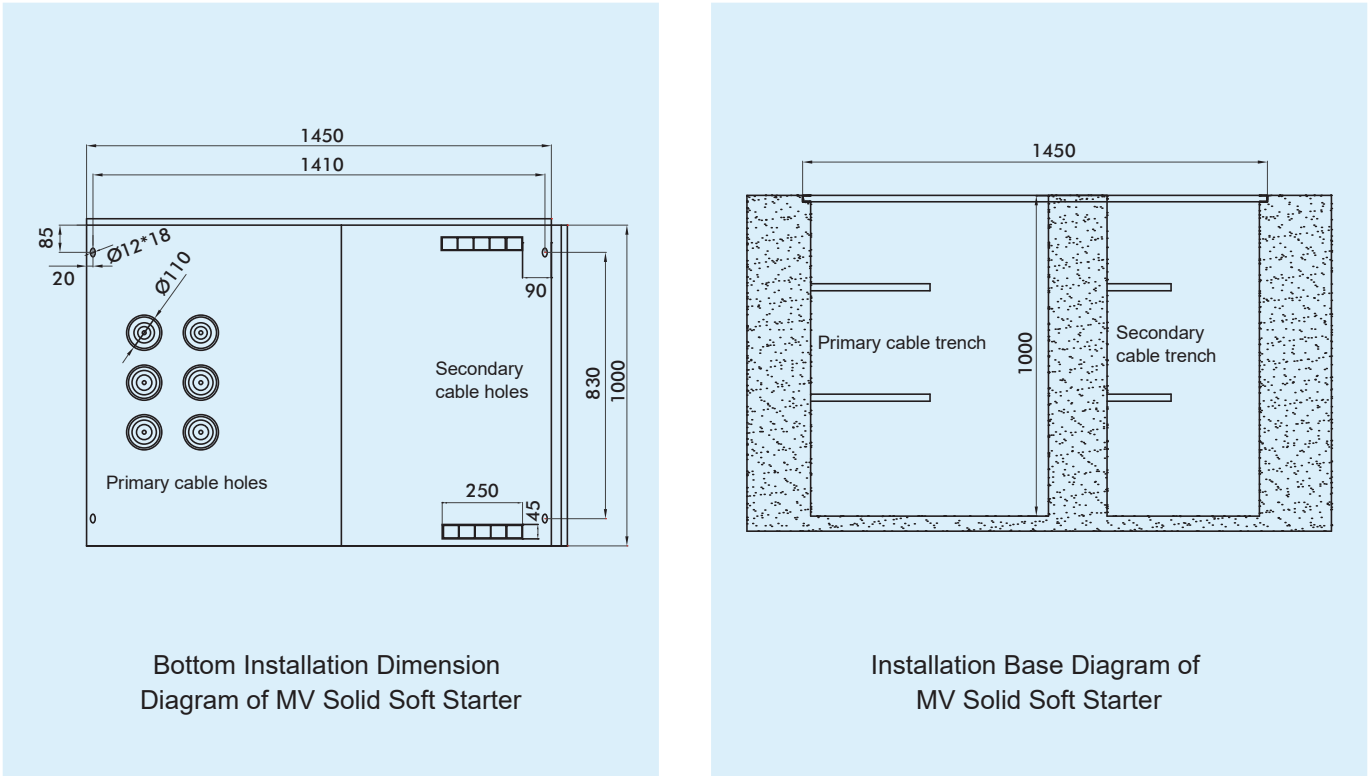

Bottom Installation Dimension
Diagram of MV Solid Soft Starter

Installation Base Diagram of
MV Solid Soft Starter

Soft Starter Selection Table

| Valve group current (A) | Voltage (kV) | Max. power of universal motor (kW) | Specifications | Cabinet dimensions (H×W×D,mm) | Weight (t) |
|-------------------------|--------------|------------------------------------|----------------|-------------------------------|------------|
| 150 | 3 | 630 | RNMV-030150 | 2300*800*1500 | 0.7 |
| 150 | 3.3 | 650 | RNMV-033150 | 2300*800*1500 | 0.7 |
| 150 | 6 | 1250 | RNMV-060150 | 2300*800*1500 | 0.7 |
| 150 | 6.6 | 1350 | RNMV-066150 | 2300*800*1500 | 0.7 |
| 150 | 10 | 2000 | RNMV-100150 | 2300*800*1500 | 0.75 |
| 150 | 11 | 2240 | RNMV-110150 | 2300*800*1500 | 0.75 |
| 330 | 3 | 1350 | RNMV-030330 | 2300*1000*1500 | 0.78 |
| 330 | 3.3 | 1500 | RNMV-033330 | 2300*1000*1500 | 0.78 |
| 330 | 6 | 2700 | RNMV-060330 | 2300*1000*1500 | 0.8 |
| 330 | 6.6 | 3000 | RNMV-066330 | 2300*1000*1500 | 0.8 |
| 330 | 10 | 4500 | RNMV-100330 | 2300*1000*1500 | 0.8 |
| 330 | 11 | 5000 | RNMV-110330 | 2300*1000*1500 | 0.8 |
| 500 | 3 | 2000 | RNMV-030500 | 2300*1100*1500 | 0.85 |
| 500 | 3.3 | 2240 | RNMV-033500 | 2300*1100*1500 | 0.85 |
| 500 | 6 | 4000 | RNMV-060500 | 2300*1100*1500 | 0.85 |
| 500 | 6.6 | 4500 | RNMV-066500 | 2300*1100*1500 | 0.85 |
| 500 | 10 | 6800 | RNMV-100500 | 2300*1100*1500 | 1 |
| 500 | 11 | 7600 | RNMV-110500 | 2300*1100*1500 | 1 |
| 700 | 3 | 2800 | RNMV-030700 | 2300*1200*1500 | 1 |
| 700 | 3.3 | 3150 | RNMV-033700 | 2300*1200*1500 | 1 |
| 700 | 6 | 5800 | RNMV-060700 | 2300*1200*1500 | 1.2 |
| 700 | 6.6 | 6300 | RNMV-066700 | 2300*1200*1500 | 1.2 |
| 700 | 10 | 9600 | RNMV-100700 | 2300*1200*1500 | 1.25 |
| 700 | 11 | 10000 | RNMV-110700 | 2300*1200*1500 | 1.25 |
| 1000 | 3 | 4000 | RNMV-0301000 | 2300*1400*1500 | 1.5 |
| 1000 | 3.3 | 4500 | RNMV-0331000 | 2300*1400*1500 | 1.5 |
| 1000 | 6 | 8200 | RNMV-0601000 | 2300*1400*1500 | 1.8 |
| 1000 | 6.6 | 9100 | RNMV-0661000 | 2300*1400*1500 | 1.8 |
| 1000 | 10 | 13500 | RNMV-1001000 | 2300*1400*1500 | 1.8 |
| 1000 | 11 | 15000 | RNMV-1101000 | 2300*1400*1500 | 1.8 |




“Three-in-one” integrated type MV Solid Soft Starter

- ✓ Fiber multiplexing technology
- ✓ Full digitalization of high voltage power modules
- ✓ Different communication interfaces
- ✓ Industrial Ethernet communication
- ✓ Remote data analysis
- ✓ Remote software upgrade




Front view

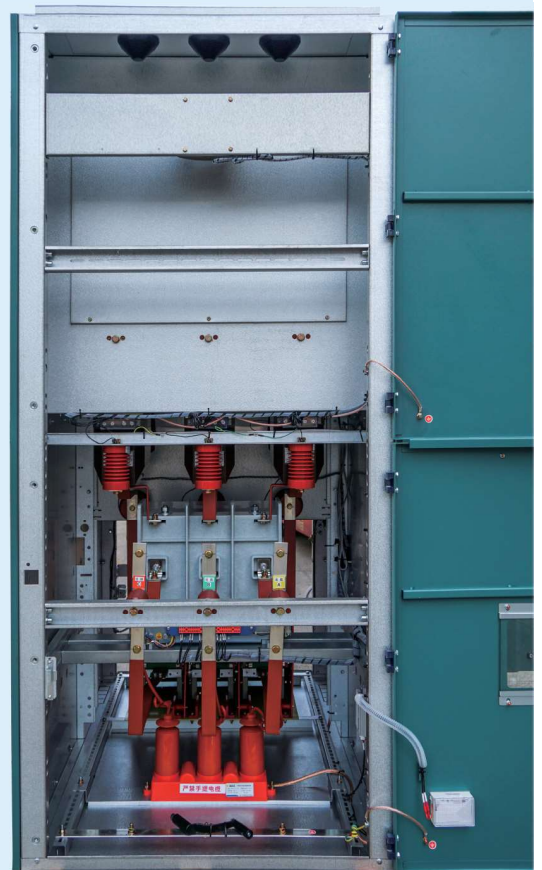


Back view


Cabinet dimensions (“Three-in-one” integrated type)

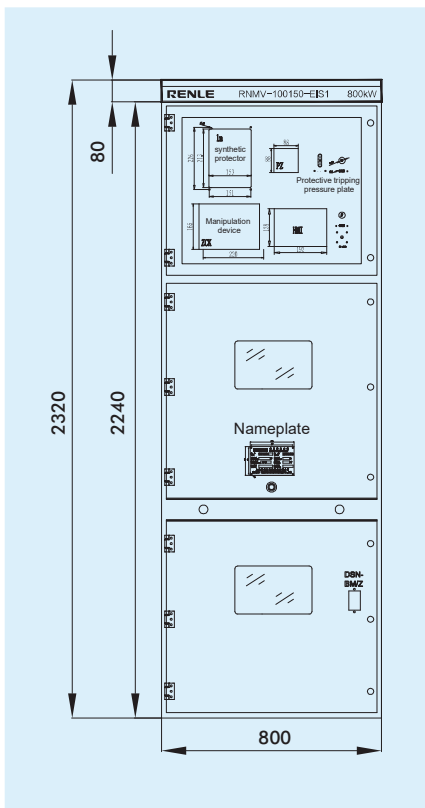

Front view


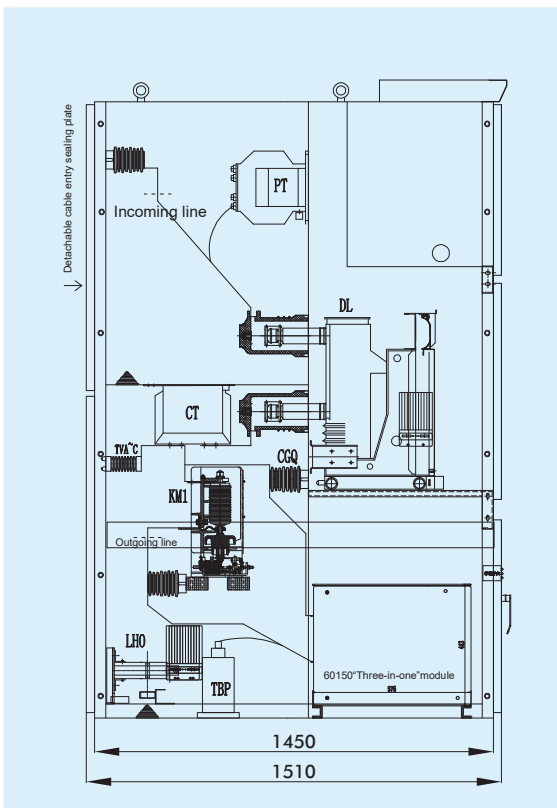


Side view

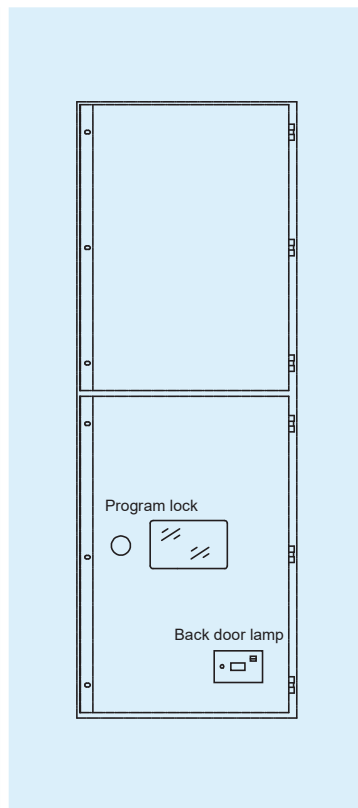

Back view

Installation method

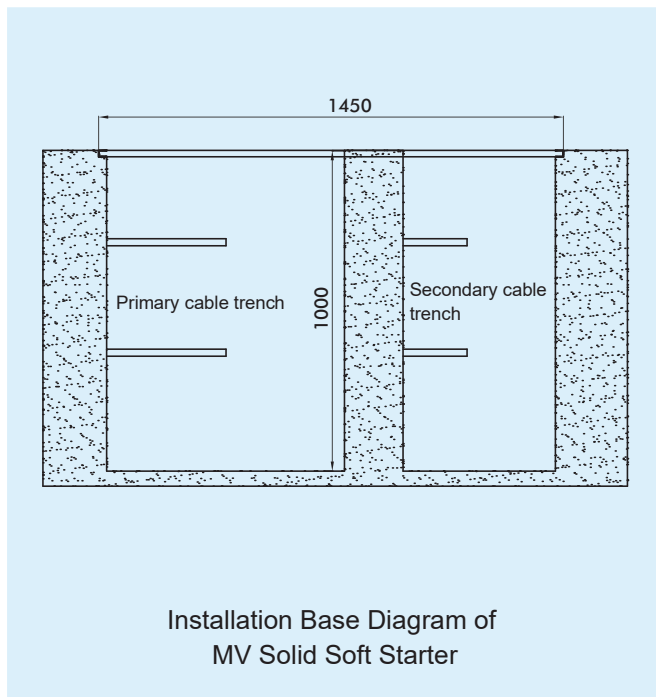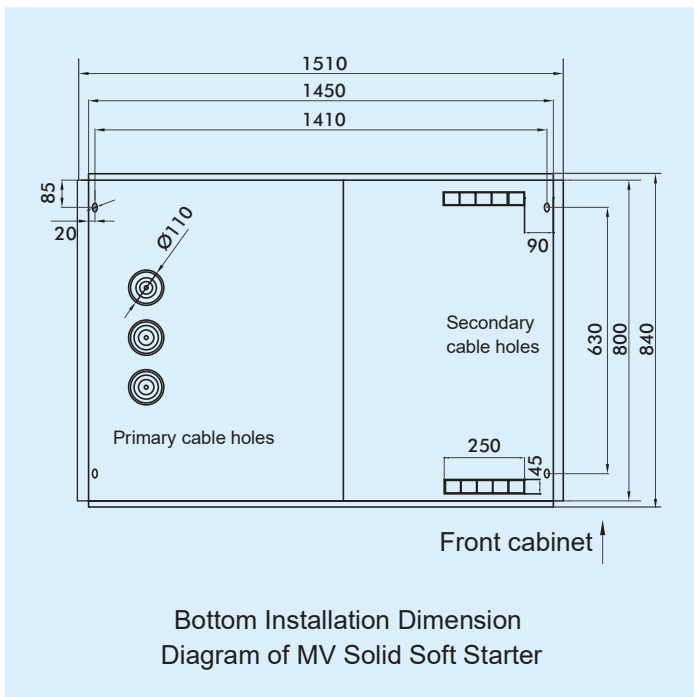

Integrated Soft Starter Selection Table

| Valve group current (A) | Voltage (kV) | Max. power of universal motor (kW) | Specifications | Cabinet dimensions (H×W×D,mm) | Weight (t) |
|-------------------------|--------------|------------------------------------|----------------|-------------------------------|------------|
| 150 | 3 | 560 | RNMV030150 | 2300*800*1500 | 0.7 |
| 150 | 3.3 | 630 | RNMV033150 | 2300*800*1500 | 0.7 |
| 150 | 6 | 1250 | RNMV060150 | 2300*800*1500 | 0.7 |
| 150 | 6.6 | 1350 | RNMV066150 | 2300*800*1500 | 0.7 |
| 150 | 10 | 2000 | RNMV100150 | 2300*800*1500 | 0.7 |
| 150 | 11 | 2240 | RNMV100150 | 2300*800*1500 | 0.7 |
| 330 | 3 | 1350 | RNMV030300 | 2300*1000*1500 | 0.85 |
| 330 | 3.3 | 1500 | RNMV033300 | 2300*1000*1500 | 0.85 |
| 330 | 6 | 2700 | RNMV060300 | 2300*1000*1500 | 0.85 |
| 330 | 6.6 | 3000 | RNMV066300 | 2300*1000*1500 | 0.85 |
| 330 | 10 | 4500 | RNMV100300 | 2300*1000*1500 | 0.85 |
| 330 | 11 | 5000 | RNMV110300 | 2300*1000*1500 | 0.85 |

We assist more industries in development, and provide them with quality products

RNMV-EI intelligent medium voltage solid state soft starter can be used in many industries, such as electric power, metallurgy, petroleum, petrochemical, mining, building materials, chemical industry, municipal etc, and provide compact, stable and reliable soft starter solution for control of high voltage motors. Renle' s soft starters have a complete set of motor and system protection functions, so they have reliable performance even in the harshest environments. With abundant user interfaces and modularization design, our intelligent soft starters an meet the starting needs of large and medium-sized general machinery in modern industries.

We are always ready to provide suitable solutions to you at any time!



Electric power industry

China Datang Corporation Datang Gansu Power Generation Co., Ltd.
China Huadian Group Co., Ltd. Guizhou Huadian Tangzhai Power Generation Co., Ltd.
China Datang Corporation Datang Lubei Power Generation Co., Ltd.
Huadian International Power Co., Ltd.
Anhui Huadian Lu'an Power Plant Co., Ltd.
China Huadian Corporation Limited Hubei Xiangyang Huadian Power Generation Co., Ltd. Shandong Wangchao Coal Power Group New Energy Power Generation Co., Ltd.
China Guodian Group Inner Mongolia Guodian Energy Investment Co., Ltd. Xilin Thermal Power Plant
Shanxi Lu'an Ronghai Power Generation Co., Ltd.
Shanxi Datang International Shentou Power Generation Co., Ltd.
State Power Investment Corporation Nanyang Yahekou Power Generation Co., Ltd.
Hengan (China) Investment Co., Ltd. Weifang Hengan Thermal Power Co., Ltd.
Hangzhou Thermal Power Group Co., Ltd. Shaoxing Shangyu Hangxie Thermal Power Co., Ltd.
China Power International Development Co., Ltd. Huanggang Dabieshan Power Generation Co., Ltd.
China Power International Development Co., Ltd. Shanxi Shentou Power Generation Co., Ltd.
China Huadian Group Co., Ltd. Shaanxi Huadian Yuheng Coal and Electricity Co., Ltd.
Shaoxing Shangyu Hangxie Thermal Power Co., Ltd.
Shandong Runyuan Biomass Power Generation Co., Ltd.
Shandong Zaozhuang Jianyang Thermal Power Co., Ltd.
Shandong Zhucheng Longguang Thermal Power Co., Ltd.
Shandong Weihai Thermal Power Group Co., Ltd.



Steel industry

Baoshan Iron & Steel Co., Ltd. Shanghai Meishan Iron & Steel Co., Ltd.
Pangang Group Co., Ltd.
Tonghua Iron and Steel Co., Ltd.
Shandong Iron and Steel Group Laiwu Iron and Steel Xinjiang Co., Ltd.
Zhongtian Iron and Steel Group Co., Ltd.
Benxi Iron and Steel (Group) Co., Ltd.
Donghai Iron and Steel Group Co., Ltd.
Xuanhua Iron and Steel Group Co., Ltd.
Ma'anshan Iron and Steel Co., Ltd.
Nanjing Iron and Steel Group Co., Ltd.
Jianlong Steel Holdings Limited
Jiangsu Xugang Iron and Steel Group Co., Ltd.
Liuzhou Iron and Steel Co., Ltd.
Wu'an Yuhua Iron and Steel Co., Ltd.
Anyang Iron and Steel Co., Ltd.
Hebei Zongheng Iron and Steel Group Co., Ltd.
Yingkou Iron and Steel Co., Ltd.
Tangshan Donghua Iron and Steel Enterprise Group Co., Ltd.
Ningxia Shenxin Special Steel Co., Ltd.
Xinji Aosen Iron and Steel Group Co., Ltd.



Chemical industry

Inner Mongolia Datang International Duolun Project with an annual output of 460,000 tons of coal-based olefins.

Shenhua Mengxi Coal Chemical Co., Ltd. 960,000 tons of stamped coke co-production 100,000 tons of methanol project.

Xinjiang Jinsheng Populus Populus Chemical Co., Ltd. annual output of 600,000 tons of nitro compound fertilizer project.

Inner Mongolia Datang International Keshigten Coal-to-Gas Co., Ltd.

Xinjiang Kingho Energy Group Co., Ltd.

Jiangxi Lanxinghuo Silicone Co., Ltd. Shanghai Chlor-Alkali Chemical Co., Ltd.

Sinopec Sichuan Vinylon Plant.

Gaomi Kingboard Chemical Co., Ltd.

Abel Chemical (Jiangsu) Co., Ltd.

Qinghai Zhonghao Natural Gas Chemical Co., Ltd.

Qinghai Salt Lake Industry Co., Ltd.

Jintaoyuan Coal Coking Group Co., Ltd.

Jiangsu Changlong Chemical Co., Ltd.

Xinjiang Shengxiong Energy Co., Ltd.

Xianglu Petrochemical (Zhangzhou) Co., Ltd.

Xinjiang Meifeng Chemical Co., Ltd.

Shanxi Hongyuan Fukang New Energy Co., Ltd.

Shaanxi Shanhua Coal Chemical Co., Ltd.

Inner Mongolia Yidong Group Dongxing Chemical Co., Ltd.

Xinjiang Yihua Chemical Co., Ltd.



Petroleum Industry

PetroChina Liaohe Oilfield Branch.

PetroChina Refining and Chemical Engineering Construction Project.

Huabei Oilfield Keda Development Co., Ltd.

PetroChina Karamay Oilfield Branch.

Qingdao PetroChina Storage Co., Ltd.

Jiangnan Petroleum Drilling Bits Co., Ltd.

China National Petroleum Corporation Qinghai Oilfield Branch.

China National Petroleum Corporation Hainan Fushan Oilfield Exploration and Development Co., Ltd.

Sinopec Natural Gas Sichuan-East Gas Transmission Pipeline Branch.

Shandong Huafeng Petroleum Technology Co., Ltd.

CNOOC Guangxi Fangchenggang Natural Gas Co., Ltd.

CNOOC Tianjin LNG Co., Ltd. CNOOC Huizhou Petrochemical Co., Ltd.

Qingdao PetroChina Storage Co., Ltd.

Sinopec Shengli Oilfield Co., Ltd.

PetroChina Sichuan Petrochemical Co., Ltd.

Sinopec Shengli Oilfield Co., Ltd.

PetroChina Dagang Oilfield Company.

Shengli Oilfield Marine Electric Co., Ltd.

PetroChina Daqing Oilfield Co., Ltd.



Coal industry

Shanxi Xiyang Fenghui Coal Industry Co., Ltd.
 Guangxi Bainah Mining Co., Ltd.
 Zaozhuang Mining (Group) Co., Ltd.
 Shanxi Lanhua Coking Coal Baoxin Coal Industry Co., Ltd.
 Xinjiang Xinsai Shuanglu Mining Co., Ltd.
 Shanxi Coal Import and Export Group Zuoyundong Gucheng Coal Industry Co., Ltd.
 Qinghai Jiangcang Coal Industry Co., Ltd.
 Shenhua Ningxia Coal Industry Group Co., Ltd.
 Guizhou Panxian Zisenyuan Group Company
 Xinjiang Tunnan Coal Industry Co., Ltd.
 Jiangxi Fengcheng Qujiang Coal Development Co., Ltd.
 Huating Coal Industry Group Co., Ltd.
 Kailuan (Group) Weizhou Mining Co., Ltd. Shanxi Provincial Coke Group Co., Ltd.
 Yutian County Guyu Coal Coking Co., Ltd. Shandong Yankuang Group Co., Ltd.
 Inner Mongolia Shendong Coal Company.
 Shanxi Coal Group Zuoquan Xinshun Coal Industry Co., Ltd.
 Jingyuan Coal Industry Group Co., Ltd.
 China Pingmei Shenma Group.



Water conservancy industry

Gansu Province Jingtaichuan Electric Power Lifting and Irrigation Administration Jingdian Large Pumping Station.
 Water Supply Project for Poverty Alleviation and Development of Ecological Immigrants in Central Gansu.
 Jinghui large pumping station in Baiyin City, Gansu Province.
 Water Lifting Project for Comprehensive Utilization of Water Resources in Ludila Hydropower Station, Binchuan County, Dali Prefecture, Yunnan Province.
 South-to-North Water Diversion Water Transfer into Miyun Reservoir Regulation and Storage Project.
 Inner Mongolia Ulan Teqian Banner Water Supply Project.
 Zhongning County Hebei Urban and Rural Water Supply Project.
 Shanghai Nanhui Collection Rainwater Pumping Station.
 Yangshapao Pumping Station of Baicheng Yinnenbai Engineering Development Co., Ltd.
 Reconstruction project of Changhe Water Plant supporting quality-based water supply of Haining City's extraterritorial water diversion project.
 Jingmen Chengdong Water System is connected to Sutai Lake Pumping Station.
 Siping Housing and Urban-Rural Development Bureau Reclaimed Water Reuse Project
 Xiaochi Outflow Pumping Station in Huangmei County, Huanggang, Hubei.
 Jialing River Water Source Project in Yuechi County, Sichuan.
 Gansu Province Yintao Water Supply Phase II Qin'an County Urban and Rural Water Supply Good Ground Beam Project.
 Liuzhou Jiaoyonggou River Improvement Project.
 Renhuai City Gonghe Reservoir secondary and tertiary pumping station.
 Tianjin Binhai New Area Central Bridge Yinhe Pumping Station.
 Harbin Economic and Technological Development Zone (Hanan Industrial New City Water Supply Booster Pumping Station).
 Zhejiang Water Conservancy and Hydropower Yaojiang River Upstream West Drainage Project.
 An important protection project in the Wuxuan County Datangxia Water Conservancy Project Reservoir Area.
 Yijingtang large-scale pumping station in Alashan League, Inner Mongolia Autonomous Region.



Paper industry

Shandong Sun Paper Co., Ltd.
 Shandong Huatai Paper Co., Ltd.
 Fuyu Chenming Paper Co., Ltd.
 Nine Dragons Paper (Taicang) Co., Ltd.
 Shanying International Holdings Co., Ltd.
 Shandong Tianzhang Paper Co., Ltd.
 Shandong Huamai Paper Co., Ltd.
 Dongguan Junye Paper Co., Ltd.
 Hubei Changjiang Huifeng Paper Co., Ltd.
 Zhejiang Rongsheng Environmental Protection Paper Co., Ltd.
 Shandong Hengyu Paper Co., Ltd.
 Shanxi Qiangwei Paper Co., Ltd.
 Shandong Tianhe Paper Co., Ltd.
 Puyang Longfeng Paper Co., Ltd.
 Jiangsu Yangzi Shengda Paper Technology Development Co., Ltd.
 Shandong Ronghua Paper Co., Ltd.
 Shandong Depak Paper Co., Ltd.
 Jiangmen Star Paper Co., Ltd.
 Shandong United Paper Co., Ltd.
 Zhejiang Kaifeng Special Paper Co., Ltd.
 Xinmi Hengfeng Paper Co., Ltd., Henan Province
 Shandong Jianghe Paper Co., Ltd.
 Vietnam Shun An Paper Co., Ltd.
 Henan Longyuan Paper Co., Ltd.



Machinery manufacturing

Goertek Inc.
 Weir Group Machinery Equipment (Shanghai) Co., Ltd.
 Sinotruk Group Jinan Truck Co., Ltd.
 Atlas Copco (Wuxi) Compressor Co., Ltd.
 HUAYI Turbomachinery (Shandong) Co., Ltd.
 FAW-Volkswagen New Technology Development Center.
 HIGH-AIR Machinery (SHANGHAI) Co., Ltd.
 Evergrande New Energy Vehicle (Guangdong) Co., Ltd.
 CATL New Energy Technology Co., Ltd.
 FS-ELLIOTT (SHANGHAI) Machinery Co., Ltd.
 Yantai Jereh Compression Equipment Co., Ltd.
 Linde Gases (Guangzhou, Suzhou) Co., Ltd.
 Shaanxi LONGi Solar Photovoltaic Technology Co., Ltd.
 Carrier Air Conditioning Sales Service (Shanghai) Co., Ltd.
 Henghao Optoelectronics Technology (Kunshan) Co., Ltd.
 Jiangsu Runyang Yueda Photovoltaic Technology Co., Ltd.
 Xuzhou Xinjing Semiconductor Technology Co., Ltd.
 Tianjin FAW Toyota Motor Co., Ltd.
 AECC Chengdu Engine Co., Ltd.
 Denier Energy Saving Technology (Shanghai) Co., Ltd.
 Yantai Moon Group Co., Ltd.
 Shanghai Kaiquan Pump (Group) Co., Ltd.
 Kaifeng Yellow River Air Separation Group Co., Ltd.
 IHI-Sullair Compression Technology(Suzhou)Co.,Ltd.
 Dengfu Machinery (Shanghai) Co., Ltd.



Follow Shanghai Renle
Professional Manufacturer for
Smart Grid • New Energy
Electric Drive



雷诺尔

Shanghai RENLE
Science&Technology Co., Ltd.

上海雷诺尔科技股份有限公司

Shanghai RENLE Science&Technology Co., Ltd.

Address: No.188 Building 1, Lane 3968, Chengbei Road, Jiading District, Shanghai, China

Zip code: 201807

Tel: +86-21-39538058, 59966666

Fax: +86-21-39538129

<http://www.renle.com>

Email: export@renle.com

National toll free service hotline: +86 800-8200-785